


**PRECAST CONCRETE  
SEPTIC TANK WITH BIOTUBE  
PUMP VAULT ASSEMBLY**

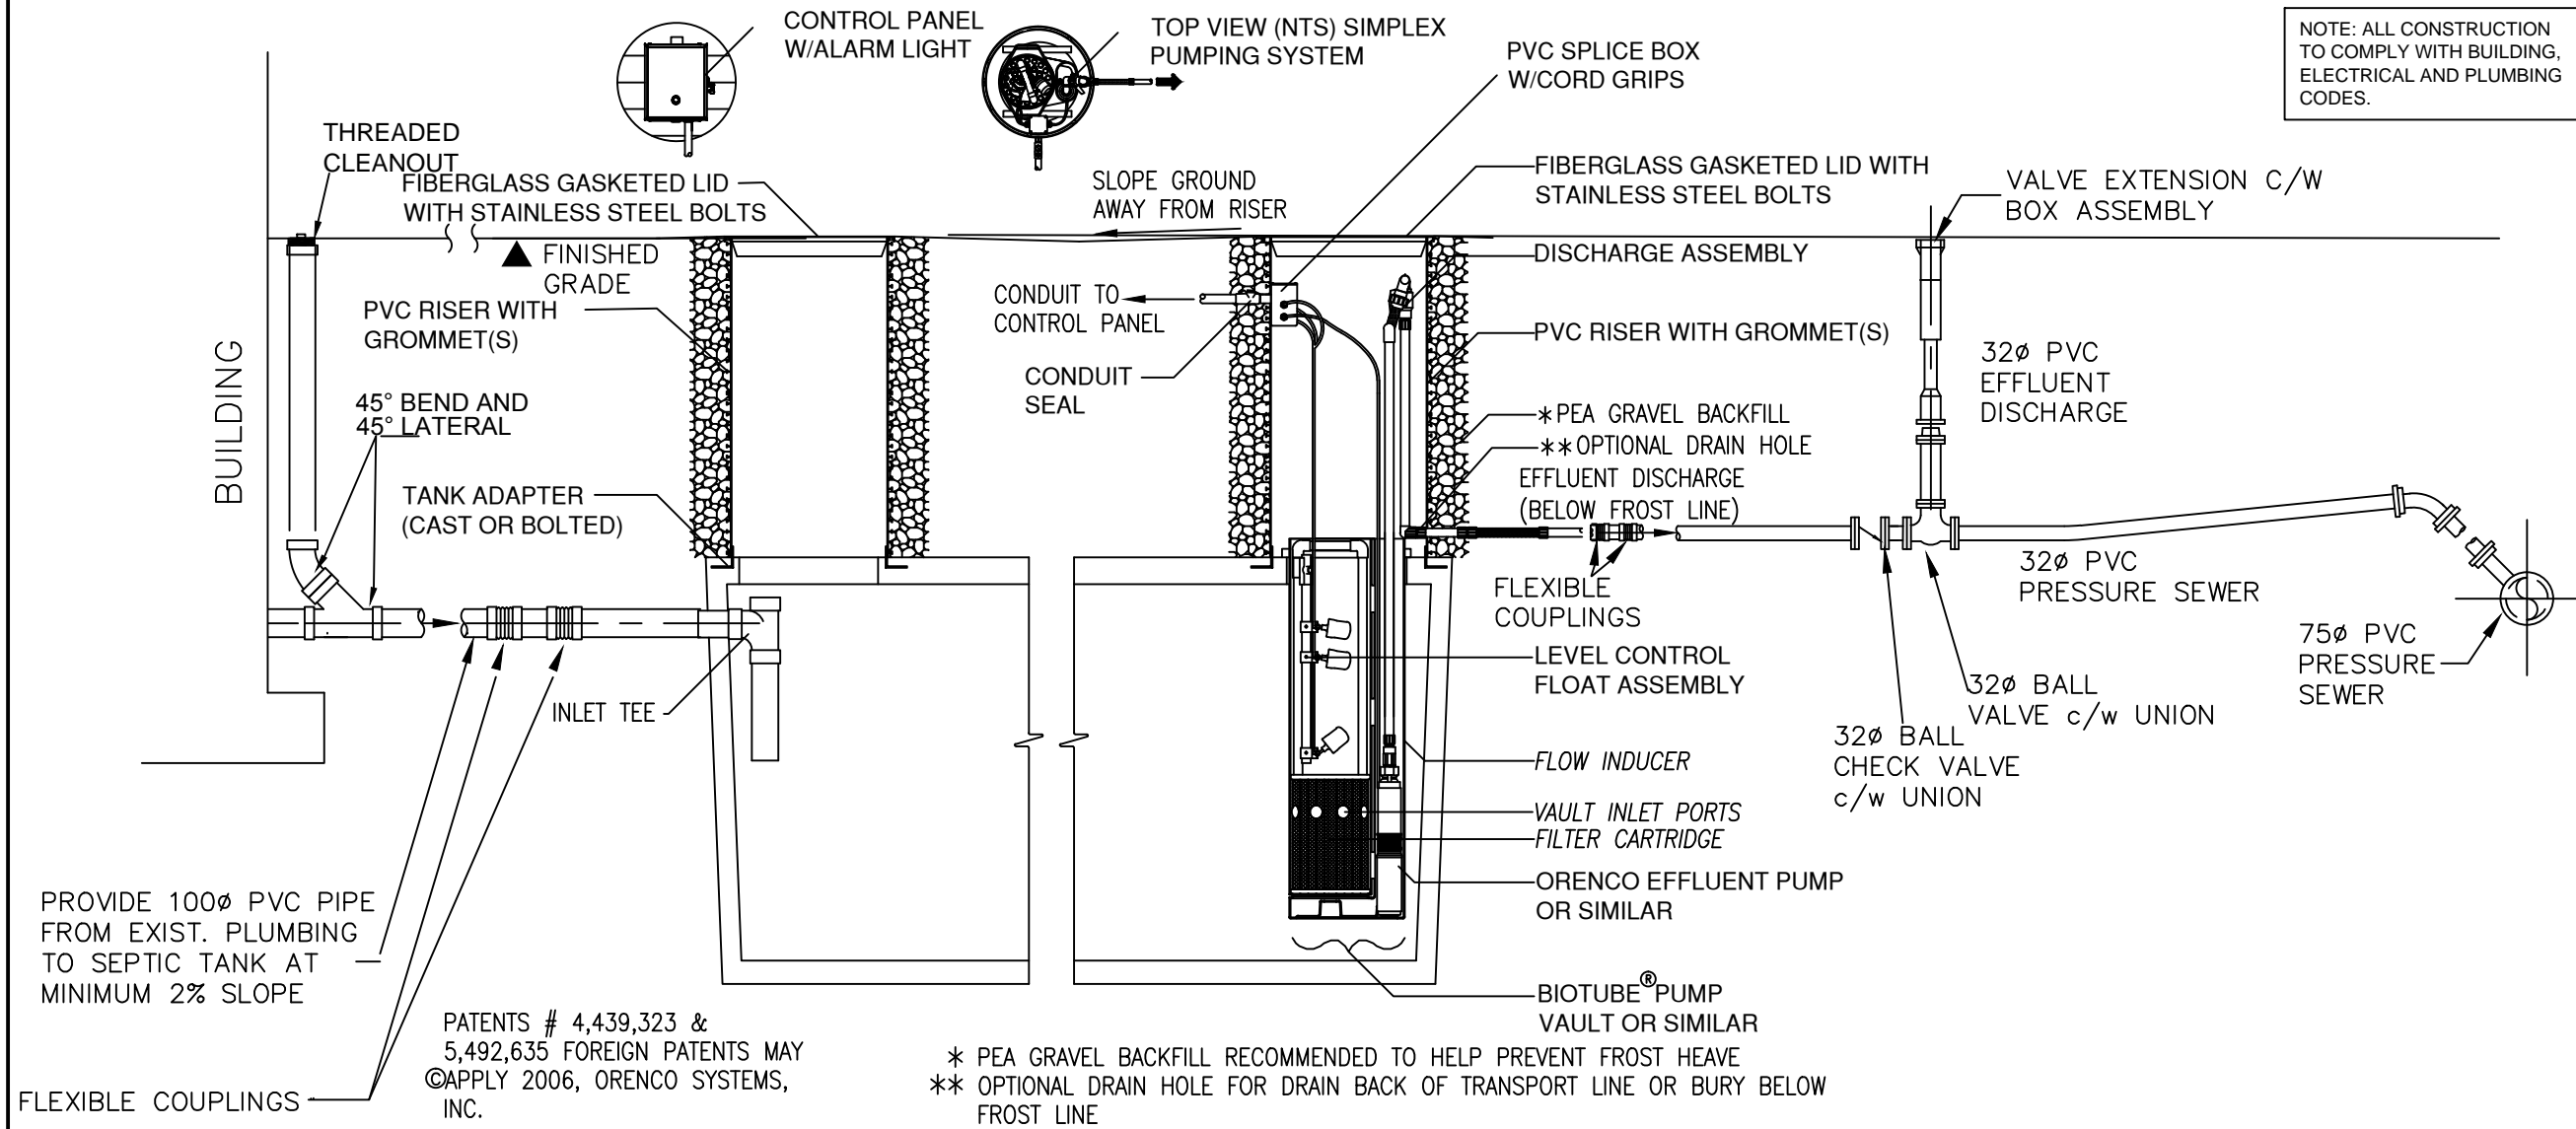

- NOTES:**
- (1) PRECAST CONCRETE OR FIBERGLASS SEPTIC TANK ASSEMBLY CAN BE USED.
  - (2) EFFLUENT PUMP CONTROLS: HL ALARM, PUMP ON AND PUMP OFF CONTROL W/PANEL INSTALLED AT 1200mm HEIGHT IN ACCESSIBLE LOCATION
  - (3) SHOP DRAWING FOR EQUIPMENT TO BE APPROVED BY MUNICIPAL ENGINEER PRIOR TO INSTALL.
  - (4) PUMP VAULT DEPTH AND RISER HEIGHT TO BE CONFIRMED BY CONTRACTOR/OWNER.
  - (5) MUNICIPAL ENGINEER TO INSPECT CONSTRUCTION PRIOR TO BURYING.
  - (6) INSULATE PIPE W/50mm RIGID INSULATION WHERE BURY IS LESS THAN 1500mm.
  - (7) ALL DIMENSIONS ARE IN METRIC UNLESS OTHERWISE INDICATED.
  - (8) CONTRACTOR/OWNER IS RESPONSIBLE FOR VERIFYING ALL EXISTING DIMENSIONS AND CONDITIONS PRIOR TO BEGINNING WORK.
  - (9) THE CONTRACTOR/OWNER IS RESPONSIBLE FOR THE SUPPLY AND DELIVERY OF ALL NECESSARY PIPE, FITTINGS AND HARDWARE AS REQUIRED TO SUCCESSFULLY COMPLETE THE WORK.

Municipality of the District of Lunenburg  
210 Aberdeen Road,  
Bridgewater Nova Scotia B4V 4G8  
Phone: (902)-541-1325  
Fax: (902)-527-1135

|   |
|---|
| PROJECT<br><b>STEP SYSTEM</b>   |
| SHEET DESCRIPTION<br><b>PRECAST CONCRETE<br/>SEPTIC TANK ASSEMBLY</b> |

|  |                                     |
|--|-------------------------------------|
| DATE 15/10/2014<br>HORIZ. SCALE NTS<br>VERT. SCALE NTS<br>DRAWN M. BOULANGER<br>CHECKED _____<br>DWG. NO. _____<br>DWG SHEET B | SHEET<br><b>1</b><br>OF<br><b>1</b> |
|--|-------------------------------------|